



**FOR METERS SHOWN IN ANSI C12.10 STANDARDS FOR WATT HOUR METERS**

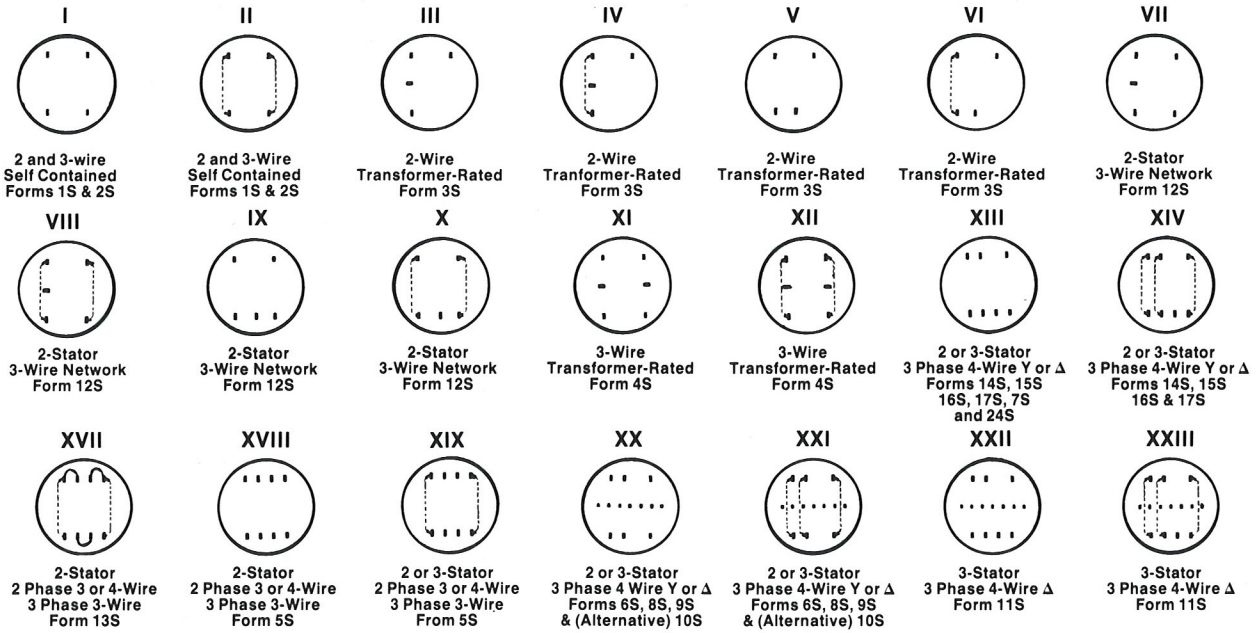


**TRANSFORMER AND TEST SWITCH INSTALLATION CIRCUIT DIAGRAMS**

**SINGLE ELEMENT—FORM 3S METER**

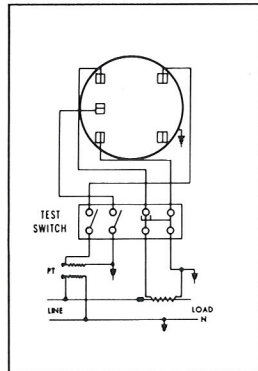


**SINGLE PHASE 2 WIRE CT AND PT**

**SINGLE ELEMENT—FORM 4S METER**

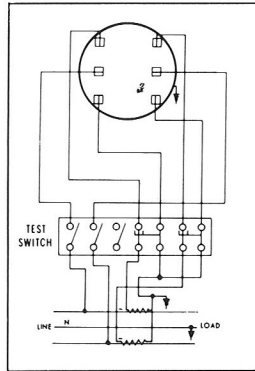


**SINGLE PHASE 3 WIRE**

**2 ELEMENT 5S METER**

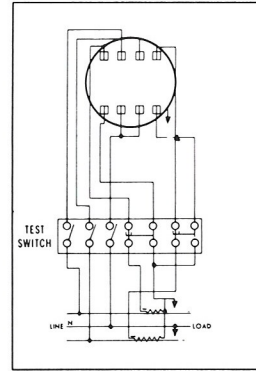


**3 PHASE 3 WIRE WITH CT'S AND PT'S OR NETWORK**

**2 ELEMENT FORM 8S METER**

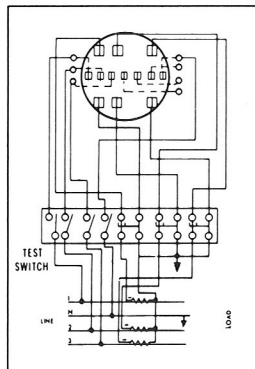


**3 PHASE 4 WIRE Δ USING CT'S**

**3 ELEMENT FORM 9S METER**

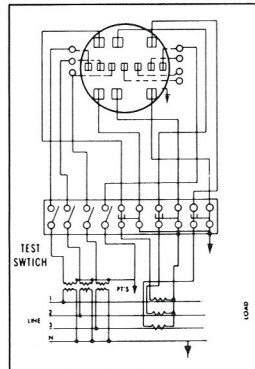

**3 PHASE 4 WIRE "Y" USING CT'S & PT'S**

**2 1/2 ELEMENT FORM 6S METER**

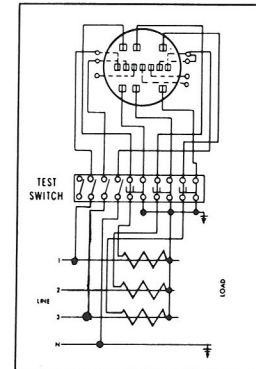

**3 PHASE 4 WIRE "Y" USING CT'S**